


BluVac Evacuation Report

Evacuation 5/20/2026, 11:19:34 AM

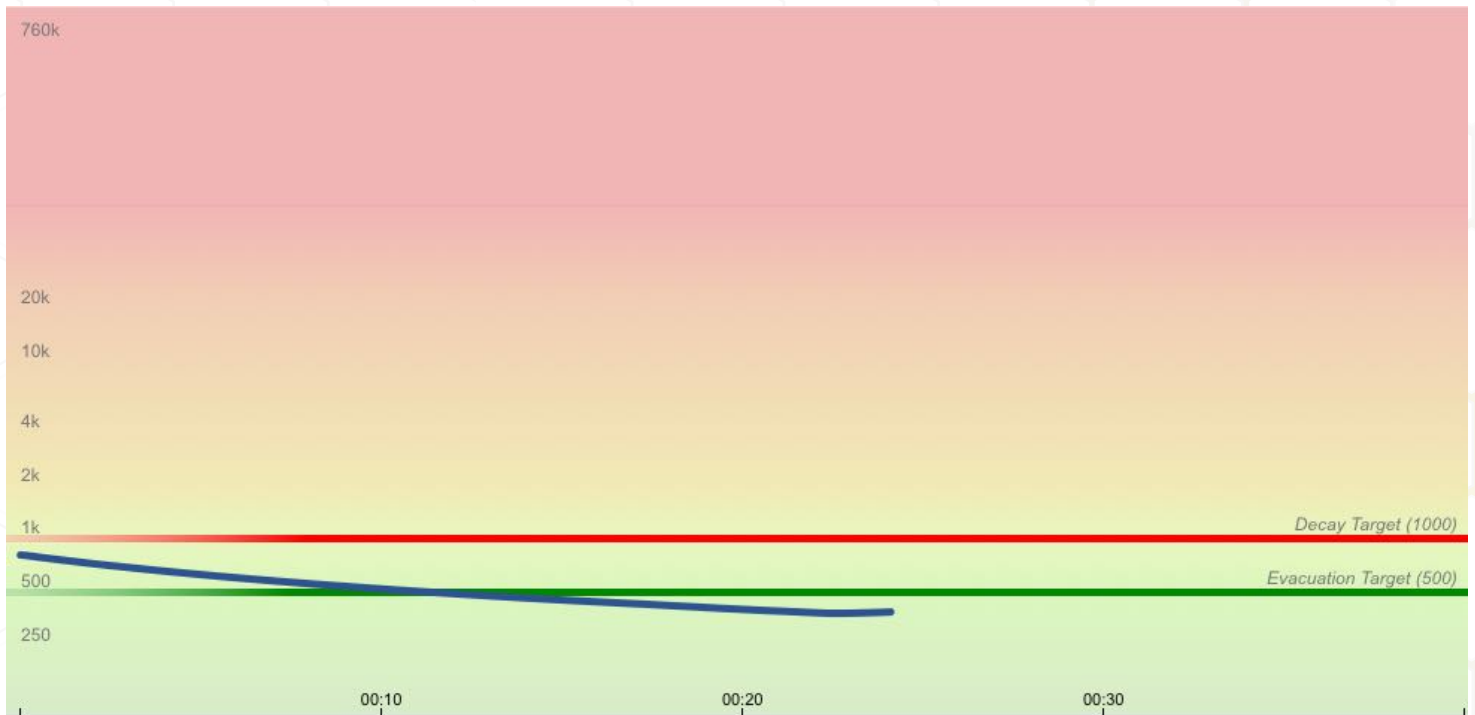

PASS

Decay Test Result

376.9 Microns

Final Vacuum

0.0 Microns/min

Avg. Decay Rate

0:22:37

Time to Ultimate P/D

0:01:28

Time in Decay

0:24:05

Total Elapsed Time

Customer

No customer data entered

Equipment

Make: --
Model: --
Serial: --

Other Stats

Ultimate Vacuum: 376.9 Microns
Avg. Ambient Temp: 83.7°F
Device Name: BluVac+ Pro
Date: 5/20/2026
Start Time: 11:19:34 AM
End Time: 11:43:40 AM

Values

Notes



36.696519, -76.250030

Scan QR Code for
site validation



ACCUTOOLS®

powered by
measureQuick